



12" MIN. BORDER GROOVES
AT 3/4" ON CENTER

MAY BE LESS THAN 60" BUT
NOT LESS THAN 48" CLEAR

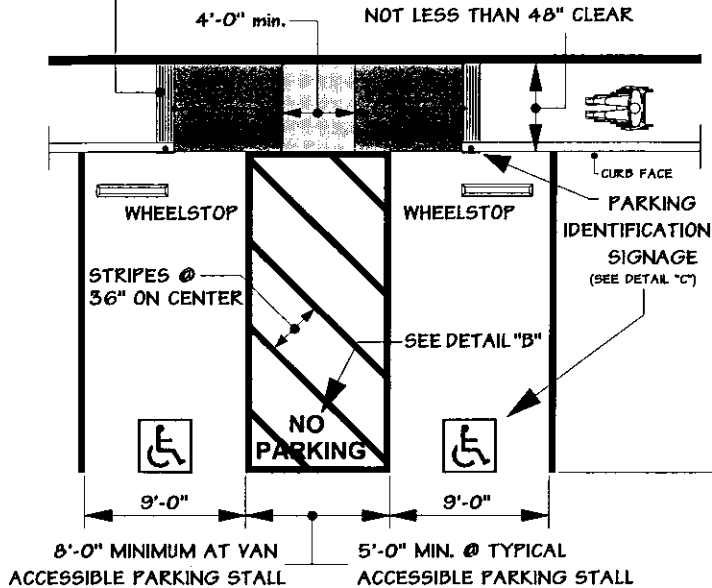

DOUBLE PARKING STALLS W / CURB-CUT RAMP

A

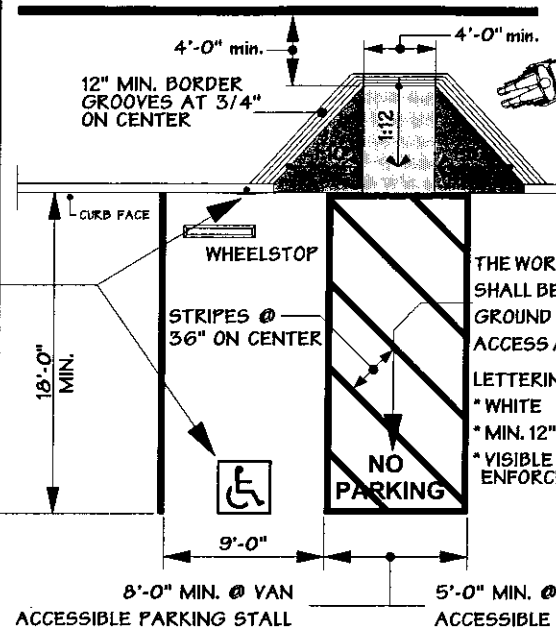

SINGLE PARKING STALL W/ CURB-CUT RAMP

B

AT PARKING LOT ENTRANCE(S)

THIS SIGN SHALL:

- BE POSTED IN A CONSPICUOUS LOCATION AT EACH ENTRANCE TO OFF-STREET PARKING FACILITIES.
- BE MIN. 17" x 22" IN SIZE
- HAVE LETTERING NOT LESS THAN 1-INCH HIGH
- HAVE BLANK SPACES FILLED IN WITH APPROPRIATE INFORMATION AS A PERMANENT PART OF THE SIGN.

(CONTACT CITY OF RIVERSIDE POLICE DEPARTMENT FOR SPECIFIC INFORMATION)

UNAUTHORIZED VEHICLES
PARKED IN DESIGNATED
ACCESSIBLE PARKING SPACES
NOT DISPLAYING DISTINGUISH-
ING PLACARDS OR LICENSE
PLATES FOR PERSONS WITH
DISABILITIES MAY BE TOWED
AWAY AT OWNER'S EXPENSE.
TOWED VEHICLES MAY BE
RECLAIMED AT:

OR BY TELEPHONING:

AT EACH PARKING SPACE (POST- OR WALL-MOUNTED)

THIS SIGN SHALL:

- BE PERMANENTLY POSTED AT EACH PARKING SPACE RESERVED FOR PERSONS WITH DISABILITIES.
- BE REFLECTORIZED.
- CONSIST OF A PROFILE VIEW OF A WHEELCHAIR WITH OCCUPANT IN WHITE ON DARK BLUE BACKGROUND.
- NOT BE SMALLER THAN 70 SQUARE INCHES IN AREA.
- BE POSTED AT MIN. 80 INCHES ABOVE THE PARKING SPACE FINISHED GRADE -OR- MAY BE CENTERED ON THE WALL AT THE INTERIOR END OF THE PARKING SPACE AT A MINIMUM HEIGHT OF 36" FROM THE PARKING SPACE FINISHED GRADE, GROUND, OR SIDEWALK.
- WHEN SPACES ARE REQUIRED TO BE VAN ACCESSIBLE, AN ADDITIONAL SIGN STATING "VAN ACCESSIBLE" SHALL BE MOUNTED BELOW THE SYMBOL OF ACCESSIBILITY.



VAN ACCESSIBLE

80" @ POSTS
36" @ WALLS

AT EACH PARKING SPACE (ON PAVED SURFACE)

THIS SIGN SHALL:

- DEPICT THE OUTLINE OF A PROFILE VIEW OF A WHEELCHAIR WITH OCCUPANT IN WHITE ON BLUE BACKGROUND.
- BE LOCATED SO THAT IT IS VISIBLE TO A TRAFFIC ENFORCEMENT OFFICER WHEN A VEHICLE IS PROPERLY PARKED IN THE SPACE.
- BE 36 INCHES WIDE BY 56" HIGH.



IDENTIFICATION OF ACCESSIBLE PARKING SPACES

C

- ACCESSIBLE PARKING SPACES SHALL BE LOCATED ON THE SHORTEST ACCESSIBLE ROUTE OF TRAVEL FROM ADJACENT PARKING TO AN ACCESSIBLE ENTRANCE.
- ACCESSIBLE PARKING SPACES SHALL BE SO LOCATED THAT PERSONS WITH DISABILITIES ARE NOT COMPELLED TO WHEEL OR WALK BEHIND PARKED CARS OTHER THAN THEIR OWN.
- ACCESSIBLE PARKING SPACES SHALL BE: MIN. 9'-0" WIDE x 10'-0" LONG
ADJACENT ACCESS AISLES SHALL BE: MIN. 5'-0" WIDE @ TYPICAL ACCESSIBLE PARKING STALL
MIN. 8'-0" WIDE @ VAN ACCESSIBLE PARKING STALL.
- THE SURFACE SLOPE OF ACCESSIBLE PARKING SPACES AND ACCESS AISLES SHALL NOT EXCEED 1/4" per 1'-0" (2%) IN ANY DIRECTION.

ACCESSIBLE PARKING REQUIREMENTS


F

TOTAL PARKING SPACES PROVIDED IN EACH PARKING AREA	REQUIRED MINIMUM NUMBER OF ACCESSIBLE SPACES
1 to 25	1
26 to 50	2
51 to 75	3
76 to 100	4
101 to 150	5
151 to 200	6
201 to 300	7
301 to 400	8
401 to 500	9
501 to 1000	2% of TOTAL
1001 & OVER	20 PLUS 1 FOR EACH 100 OVER 1000

- ONE IN EVERY EIGHT ACCESSIBLE SPACES, BUT NOT LESS THAN ONE, SHALL BE SERVED BY AN ACCESS AISLE 96 INCHES WIDE MINIMUM AND SHALL BE DESIGNATED VAN ACCESSIBLE.
- AT LEAST 10 PERCENT OF THE TOTAL NUMBER OF PARKING SPACES AT OUTPATIENT UNITS AND FACILITIES PROVIDING MEDICAL CARE AND OTHER SERVICES FOR PERSONS WITH MOBILITY IMPAIRMENTS SHALL BE ACCESSIBLE.

REQUIRED ACCESSIBLE PARKING STALLS

D

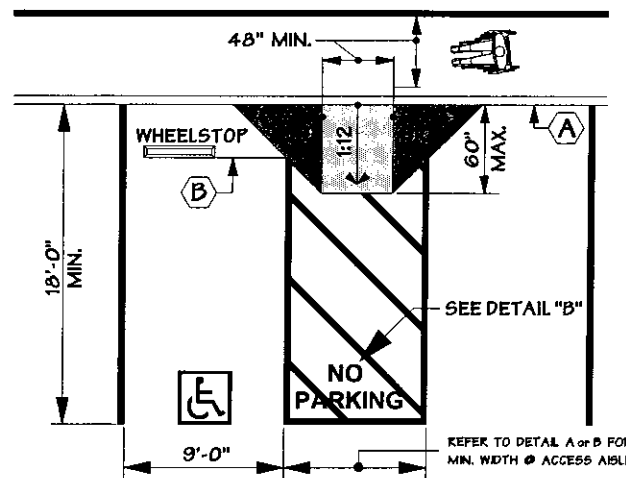

!!! CAUTION !!!

- A BUILT-UP CURB RAMP MAY ONLY BE USED WHEN CURB HEIGHT DOES NOT EXCEED 5 INCHES ABOVE ADJACENT PARKING SURFACE.
- WHEELSTOP SHALL BE POSITIONED SUCH THAT THE LEADING EDGE WILL PREVENT THE TIRE FROM CONTACTING THE SIDE FLARED PORTION OF THE BUILT-UP CURB RAMP.

SINGLE PARKING STALL W/ BUILT-UP CURB RAMP

E



City of Riverside Building & Safety Division DISABLED ACCESS STANDARDS

SCALE NONE

PGH 6/02
DRAWN DATE

REV. DATE APPR.
1 2/13/03 PGH

2
3
4
5

ACCESSIBLE
PARKING &
PATHS OF TRAVEL

RDA - 1.0

SHEET